

二级箱


熔断式开关

改为漏电保护器 透明型

LL2 L3 N PE

HF 41-400/3

DZ20Y-400Y/3300
Ie=250A

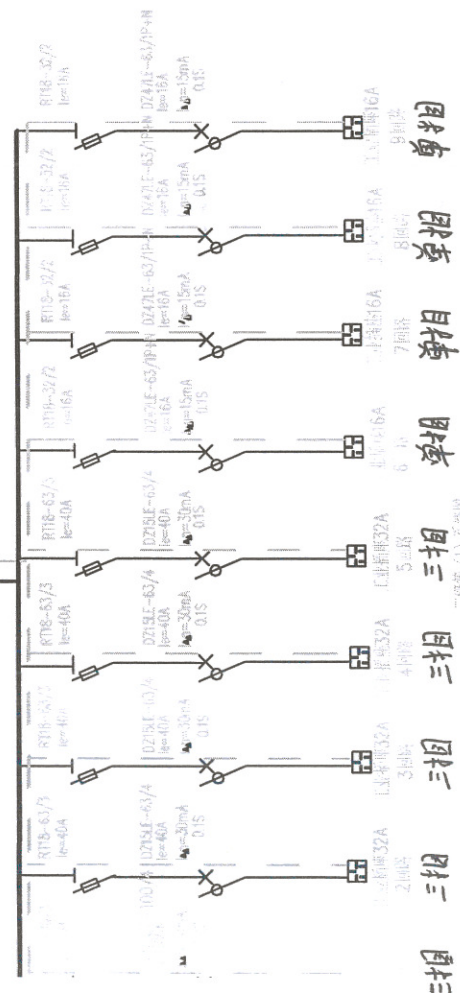


熔断式开关


改为漏电保护器 透明型

LL2 L3 N PE

HF 41-400/3

DZ20Y-400Y/3300
Ie=100A

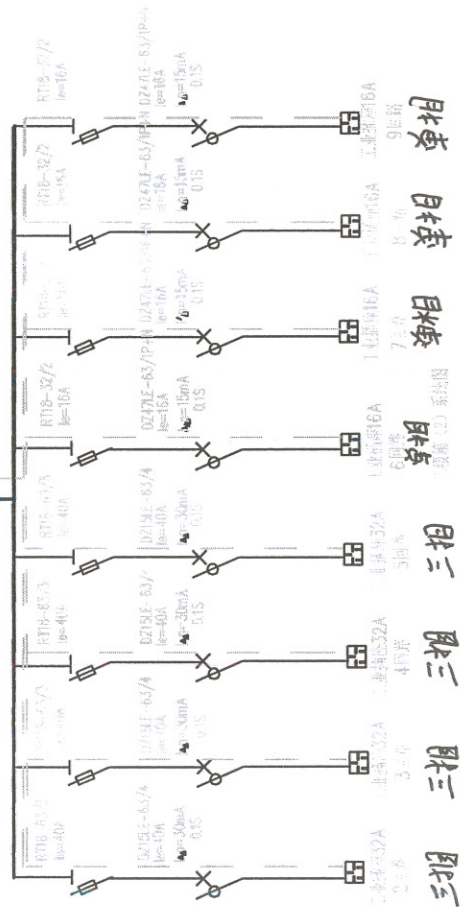

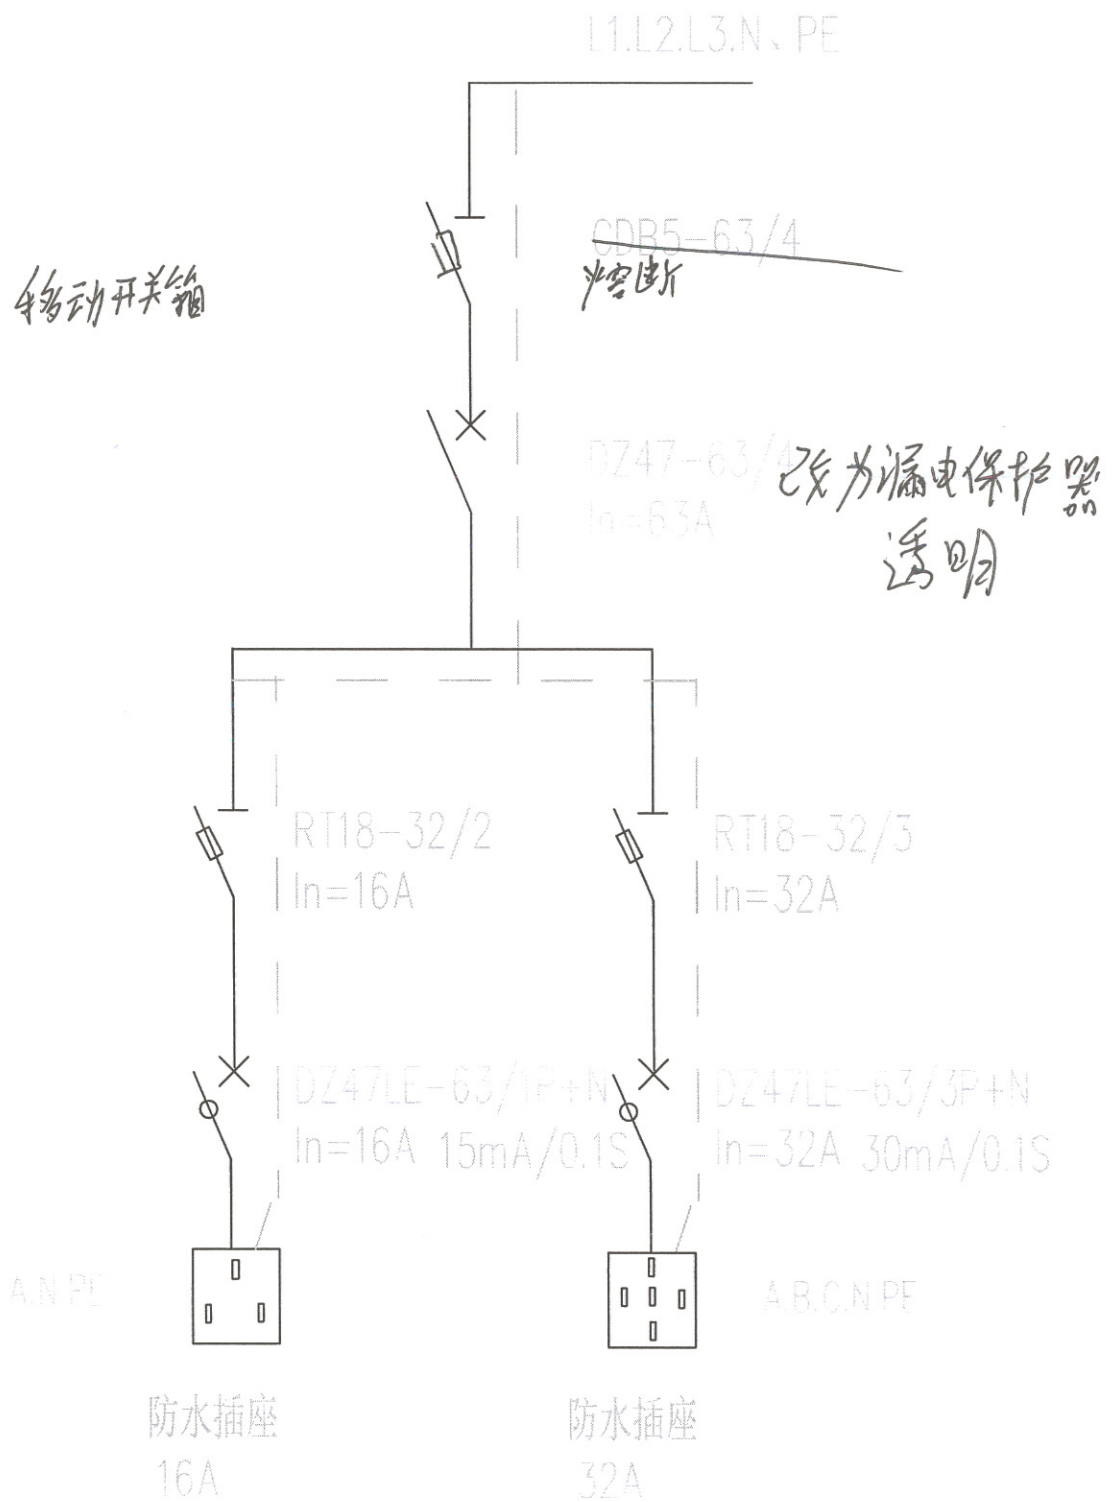

开关箱 (A) 系统图

